

Location

Country: USA
State: OKLAHOMA
City: OKLAHOMA_CITY_WILL_ROGERS_WOR
Elevation: 1,305 ft.
Bin Weather Data File Source: TMY3

Return Air Conditions Input

Return Air Dry-Bulb Temperature: 75.0 °F
Return Air Relative Humidity: 50.0 %
Actual Air: 0.073 lbs/cu.ft.

Air Movement Input

Makeup Airflow: 5,000 cfm

Cooling Data Input

Avg. Cooling Efficiency: 0.98 kW/ton

Economizer Type Input

Economizer Type: Enthalpy Economizer Control

Blended Utility Rate Input

Electrical Rate: 0.10 \$/kWh

Operating Schedule

January: False
February: False
March: False
April: True
May: True
June: True
July: True
August: True
September: True
October: False
November: False
December: False

Days Per Week: 7

12:00 AM to 01:00 AM: True
01:00 AM to 02:00 AM: True
02:00 AM to 03:00 AM: True
03:00 AM to 04:00 AM: True
04:00 AM to 05:00 AM: True
05:00 AM to 06:00 AM: True
06:00 AM to 07:00 AM: True
07:00 AM to 08:00 AM: True
08:00 AM to 09:00 AM: True
09:00 AM to 10:00 AM: True
10:00 AM to 11:00 AM: True
11:00 AM to 12:00 PM: True
12:00 PM to 01:00 PM: True
01:00 PM to 02:00 PM: True
02:00 PM to 03:00 PM: True
03:00 PM to 04:00 PM: True
04:00 PM to 05:00 PM: True
05:00 PM to 06:00 PM: True
06:00 PM to 07:00 PM: True
07:00 PM to 08:00 PM: True
08:00 PM to 09:00 PM: True
09:00 PM to 10:00 PM: True
10:00 PM to 11:00 PM: True
11:00 PM to 12:00 PM: True

Note: Output values are estimates only and actual results may vary.

Run Tag: Tag Here...
 Project Name: Project Name Here...
 Address: Address Here...
 City, State Zip: City, State Zip Here...
 Country: Country Here...


Prepared By: User Name Here...
 Company: Company Name Here...
 Phone: Your Phone Number...
 Fax: Your Fax Number...
 Email: Your Email Address...

	<u>JAN</u>	<u>FEB</u>	<u>MAR</u>	<u>APR</u>	<u>MAY</u>	<u>JUN</u>	<u>JUL</u>	<u>AUG</u>	<u>SEP</u>	<u>OCT</u>	<u>NOV</u>	<u>DEC</u>	<u>TOTAL</u>
<u>Economizer Hours Detail</u> Economizer Hours:	0	0	0	400	280	88	13	40	160	0	0	0	981
<u>Economizer Energy Savings Detail</u> Cooling Electric Savings:	\$0	\$0	\$0	\$348	\$236	\$34	\$2	\$8	\$113	\$0	\$0	\$0	\$741
<u>Economizer Electric Savings Detail</u> Cooling Electric Savings (kWh):	0	0	0	3,480	2,357	342	22	79	1,130	0	0	0	7,410
<u>Economizer Cooling Capacity Detail</u> Net Cooling Capacity (mbh):	0	0	0	42,606	28,855	4,191	269	970	13,840	0	0	0	90,731

Note: Output values are estimates only and actual results may vary.

Economizer Cooling Savings


Economizer Cooling Savings by Month

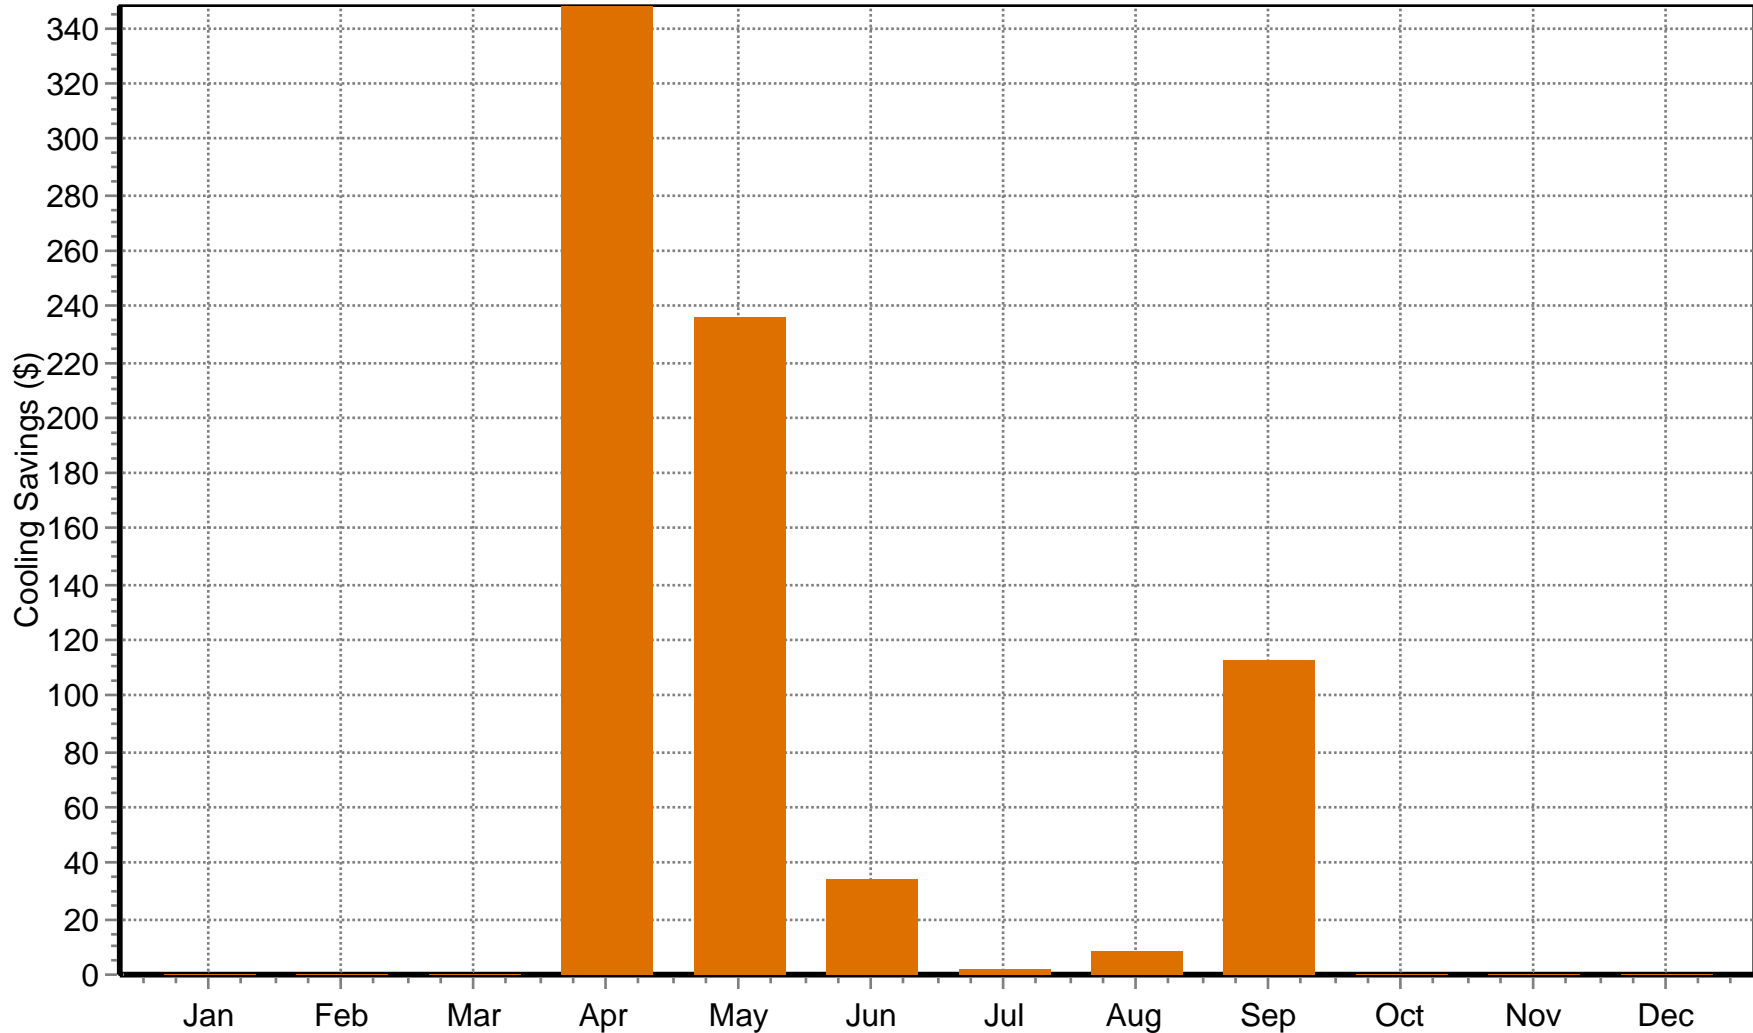

Note: Output values are estimates only and actual results may vary.

Economizer Cooling Electric Savings


Economizer Cooling Electric Savings by Month

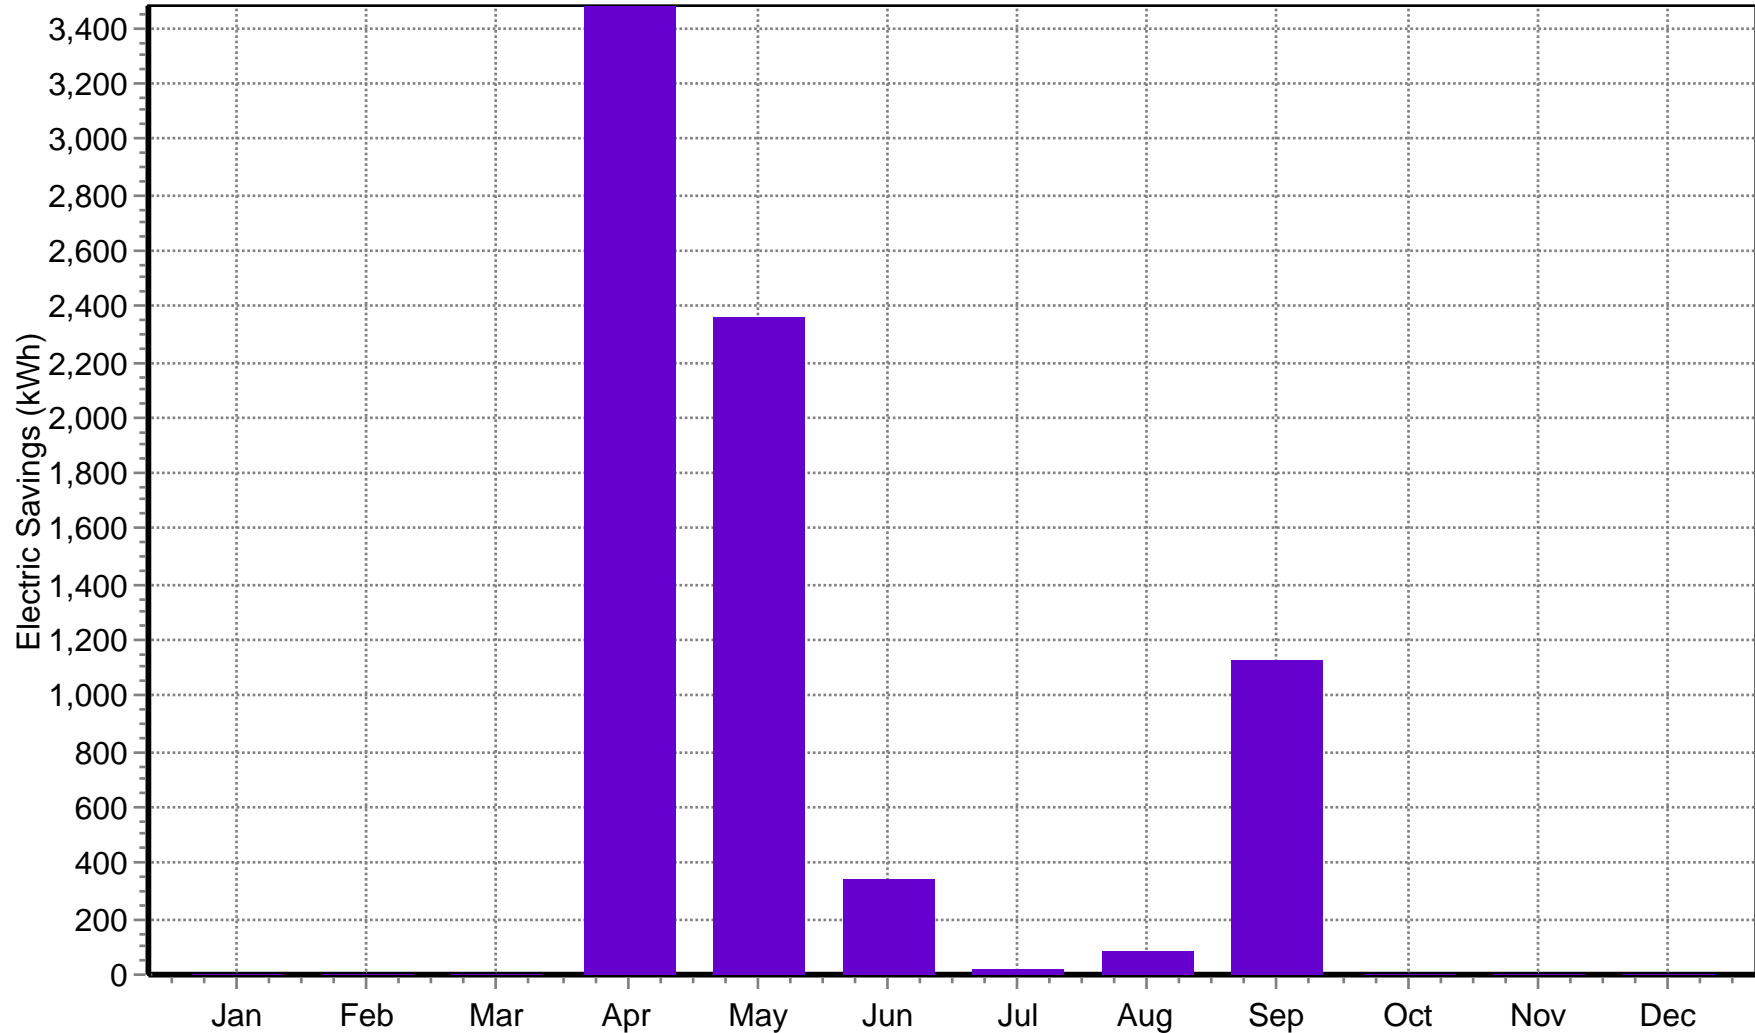

Note: Output values are estimates only and actual results may vary.

Economizer Cooling Capacity

Economizer Cooling Capacity by Month

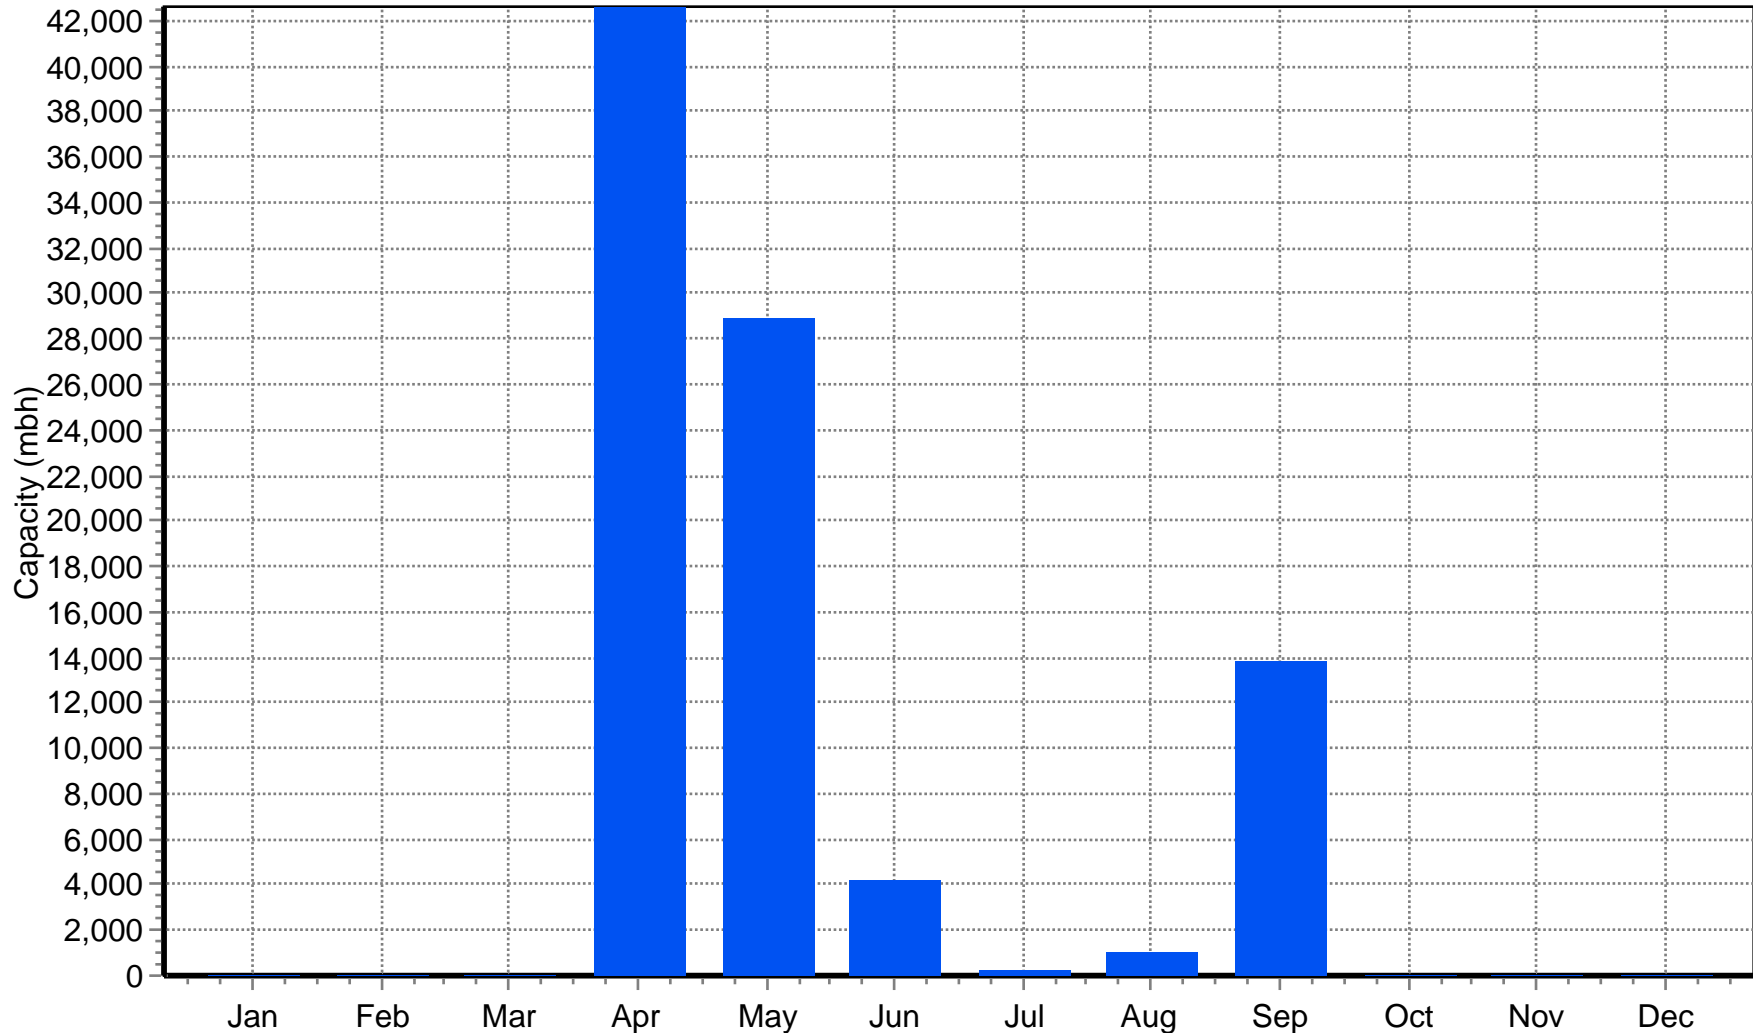

Note: Output values are estimates only and actual results may vary.